GROUTED BROKEN CONCRETE RETAINING WALL

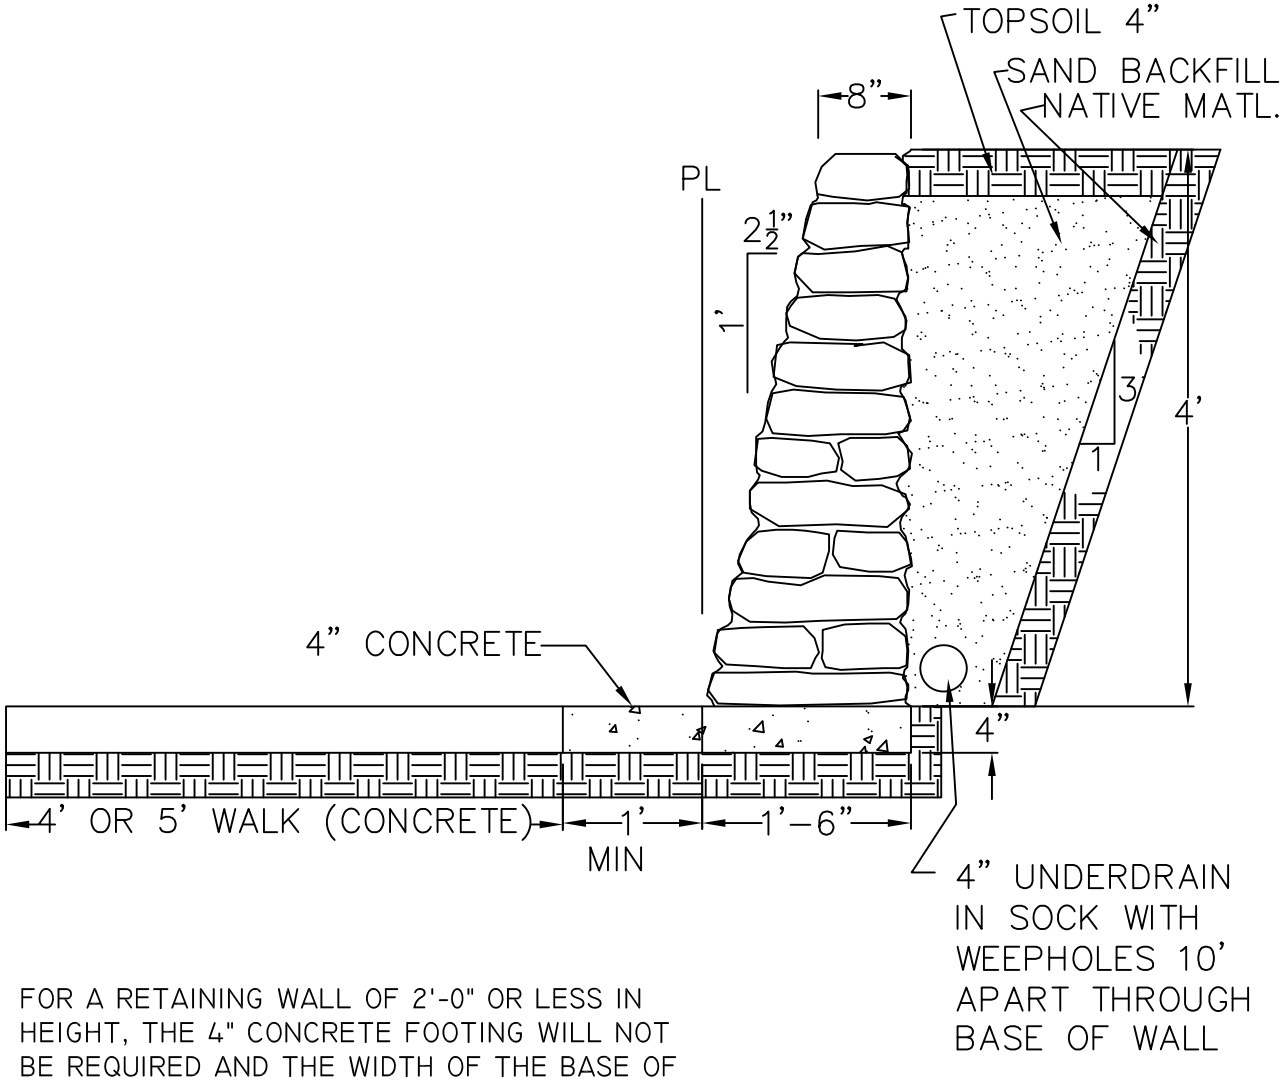

FOR A RETAINING WALL OF 2'-0" OR LESS IN HEIGHT, THE 4" CONCRETE FOOTING WILL NOT BE REQUIRED AND THE WIDTH OF THE BASE OF THE WALL MAY BE REDUCED TO A MINIMUM OF 1'-0" WITH THE BASE EXTENDED TO A DEPTH OF 0'-6" BELOW THE TOP OF WALK.

WHERE THE HEIGHT OF THE RETAINING WALL IS GREATER THAN 4'-0", THE FOOTING AND BASE OF THE RETAINING WALL SHALL BE INCREASED $2\frac{1}{2}$" IN WIDTH FOR EVERY 1'-0" OF ADDITIONAL HEIGHT.

CITY OF WYOMING
ENGINEERING DEPARTMENT

GROUTED BROKEN CONCRETE RETAINING WALL

DRAWN BY- KJM	I-29B
CHECKED BY- JOO	
DATE DRAWN- 8-11-2003	
DATE REVISED- 5-09-2016	