


DIAMETER OF SEWER	SIZE OF Y BRANCH	SIZE OF REDUCER	DIAMETER OF DROP PIPE
8"	8" X 6"	6" X 4"	4"
6"	6" X 4"	NONE	4"

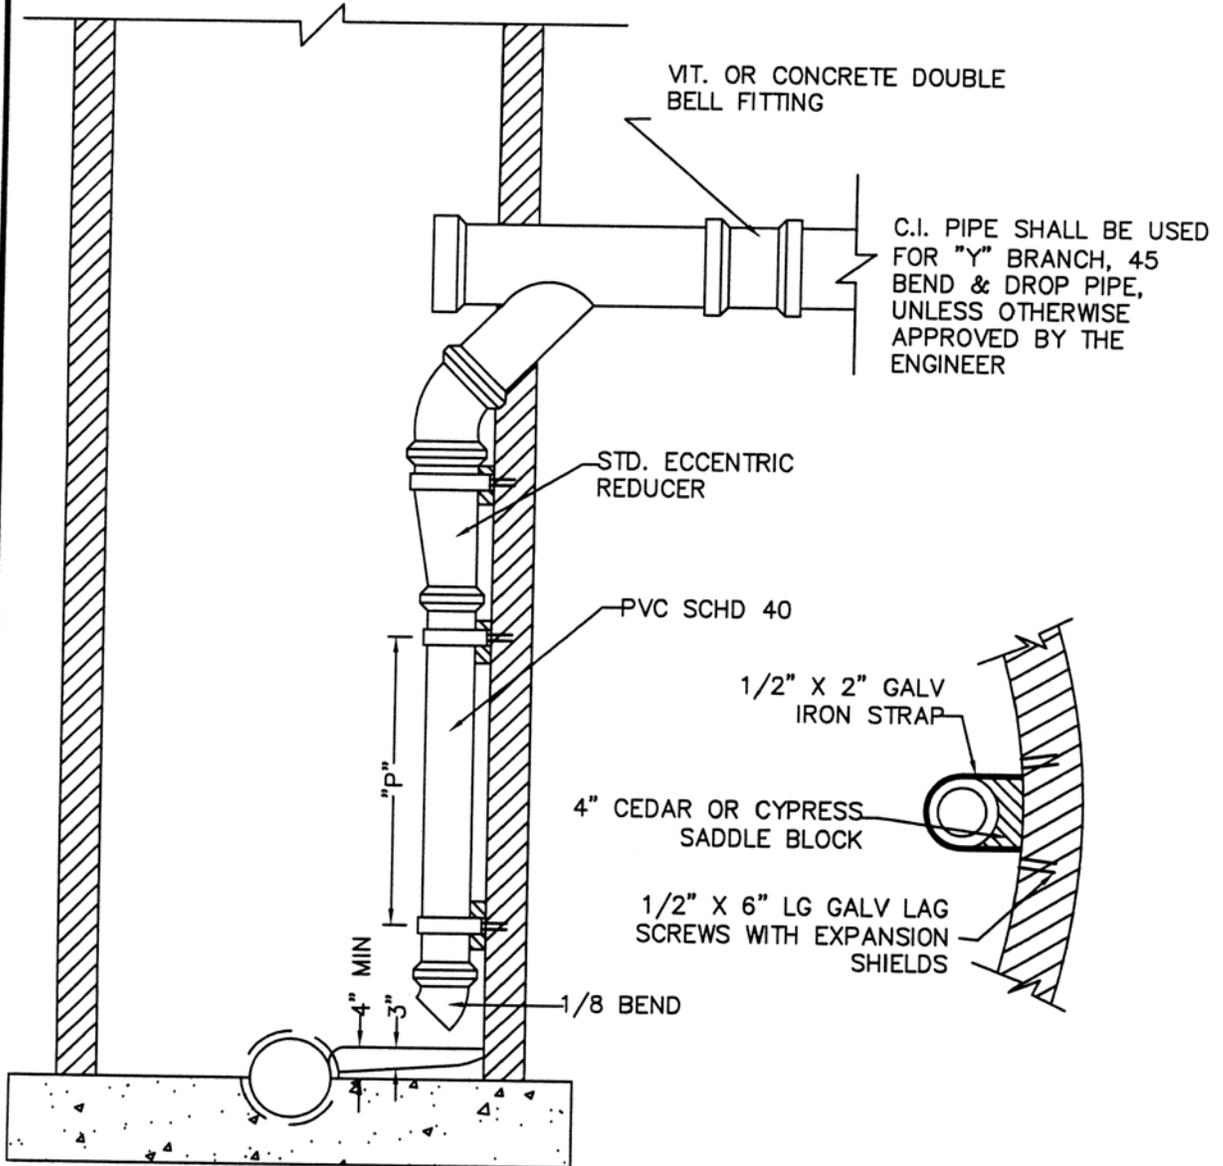

SEWERS MINIMUM DROP = 3'-6"

P=5' MAX. SPACING WITH AT LEAST 3 STRAPS USED FOR EACH INSTALLATION.

THE FORMING OF A CHANNEL IN THE BENCH OF AN EXISTING MANHOLE WILL BE REQUIRED UNLESS APPROVED BY THE ENGINEER.

THE FORMING OF ANY CHANNEL MUST BE MADE AS DIRECTED BY THE ENGINEER.

INSIDE DROP CONNECTION

CITY OF WYOMING  
ENGINEERING DEPARTMENT

**INSIDE DROP  
CONNECTION**

DRAWN BY- ML  
CHECKED BY- RH  
DATE DRAWN- 9-5-2003  
DATE REVISED-

S-12