


PRECAST SANITARY SEWER MANHOLE

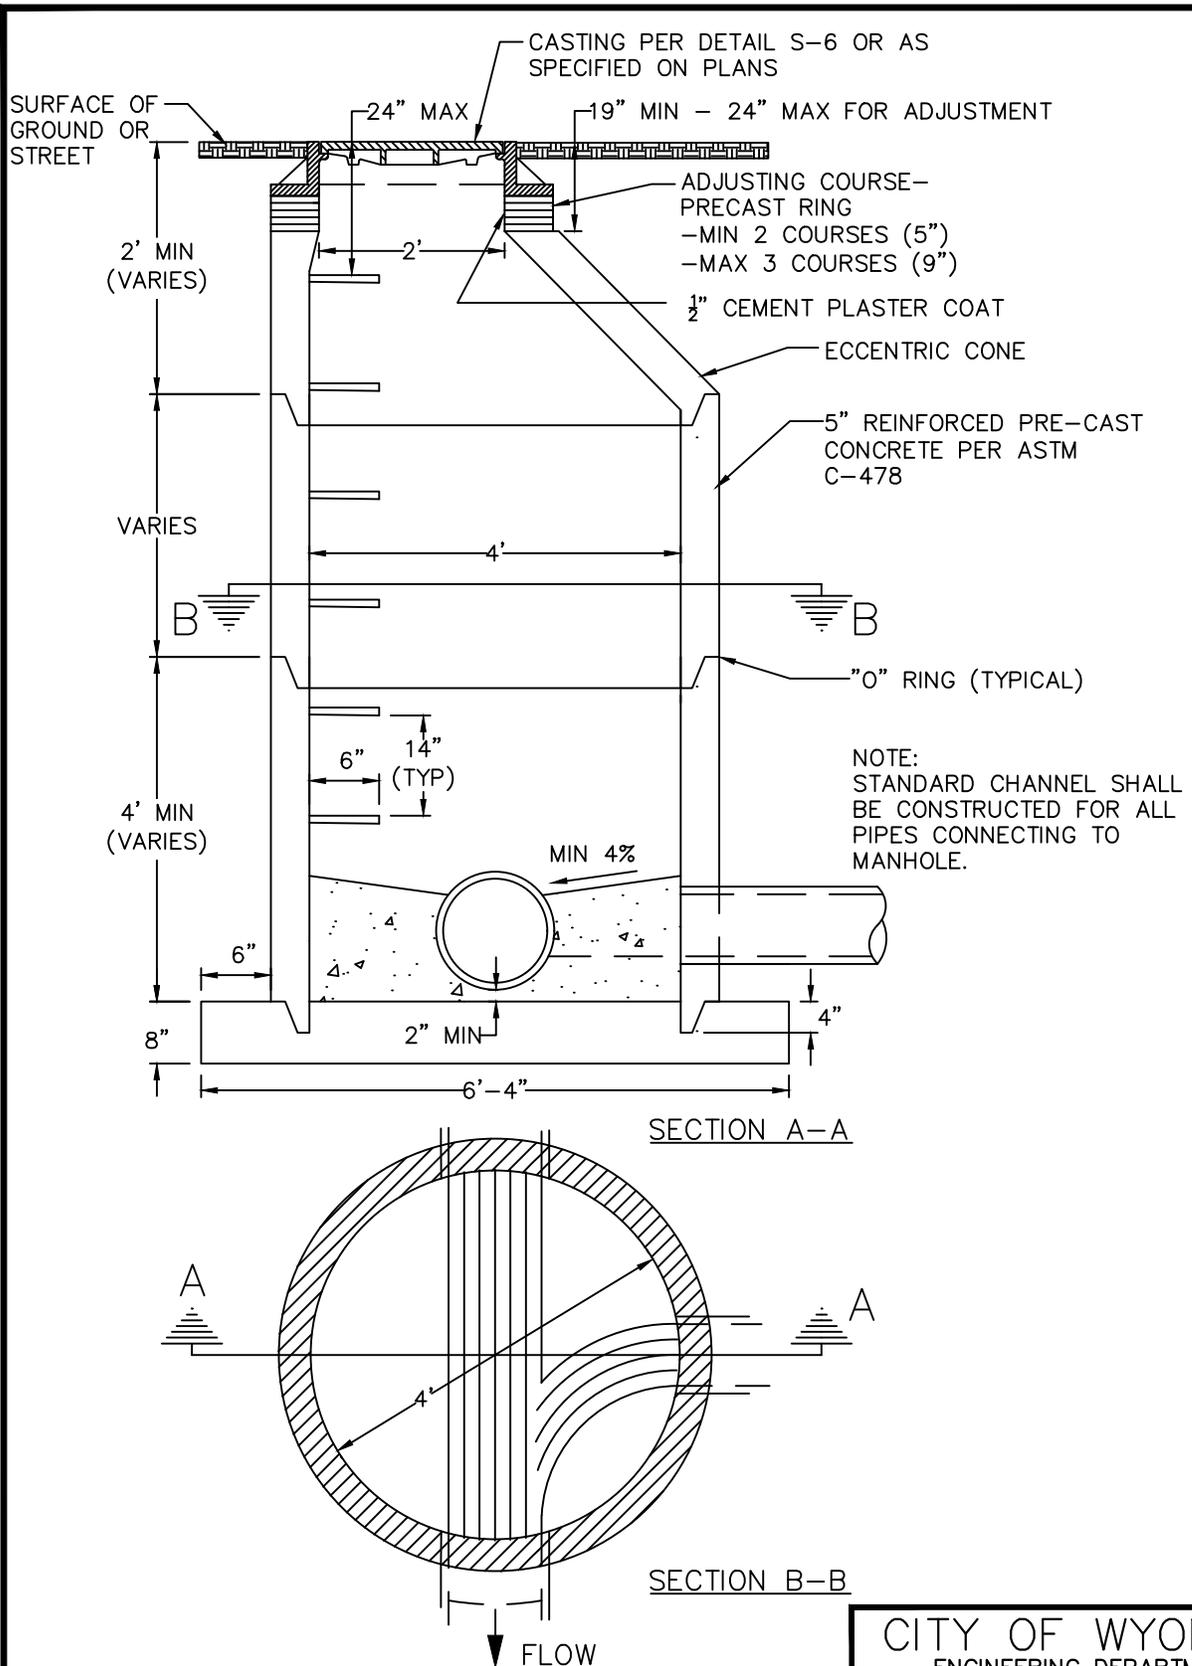

(IN HIGH WATER TABLE AREAS AN APPROVED WATERPROOFING SHALL BE APPLIED TO THE OUTSIDE OF THE MANHOLE)
 NOTE:
 • WHERE SEWER PIPE IS JOINED INTO MH, USE FLEXIBLE WATER TIGHT CONNECTION SUCH AS A-LOK, KORNSEAL OR APPROVED EQUAL
 • BELOW 15' DEPTH MEASURED FROM PRESENT GROUND SURFACE, MANHOLE WALLS SHALL BE 12" THICK AND DIAMETER OF BASE 7'4"

CITY OF WYOMING ENGINEERING DEPARTMENT	
PRE-CAST SANITARY SEWER MANHOLE	
DRAWN BY - KJM	S-7
CHECKED BY - JO	
DATE DRAWN - 5-2016	
DATE REVISED - 5-2016	