


SECTION A-A

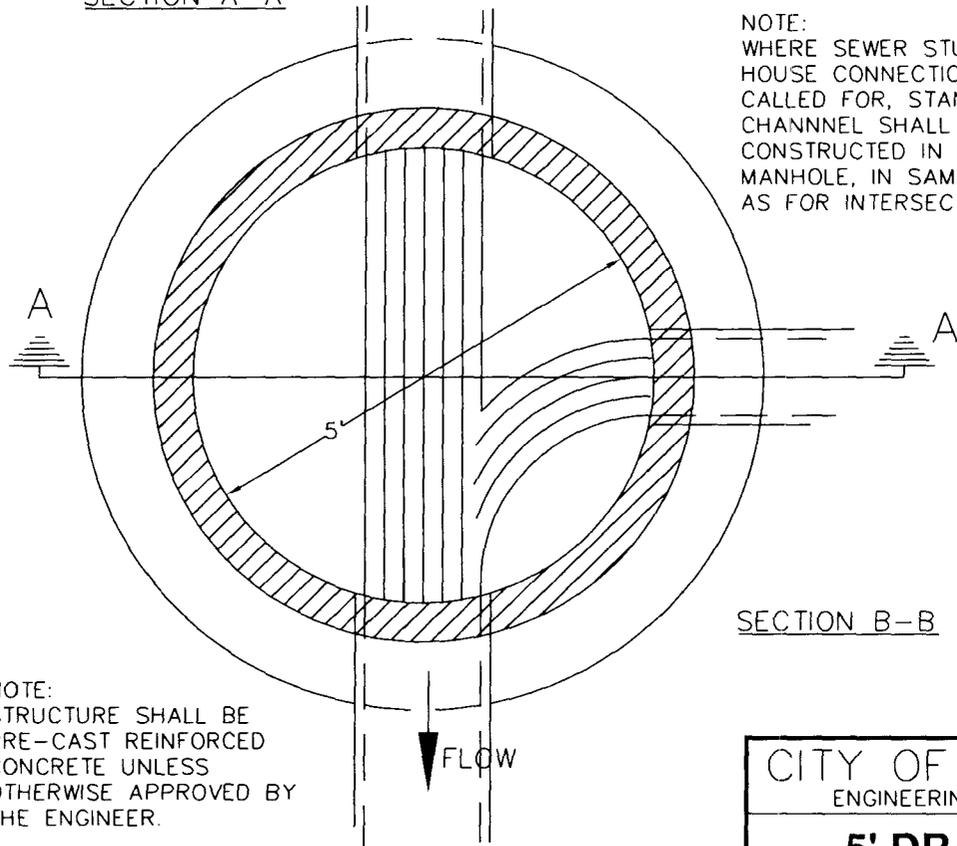

SECTION B-B

NOTE:
STRUCTURE SHALL BE
PRE-CAST REINFORCED
CONCRETE UNLESS
OTHERWISE APPROVED BY
THE ENGINEER.

NOTE:
BELOW 15' DEPTH MEASURED
FOR PRESENT GROUND
SURFACE, MANHOLE WALLS
SHALL BE 12" THICK AND
DIAMETER OF BASE 8'4"

CITY OF WYOMING
ENGINEERING DEPARTMENT

**5' DRAINAGE
STRUCTURE**

DRAWN BY- ML
CHECKED BY- RH
DATE DRAWN- 8-22-2003
DATE REVISED 3-3-2009

S-7B

5' DRAINAGE STRUCTURE