


SECTION A-A

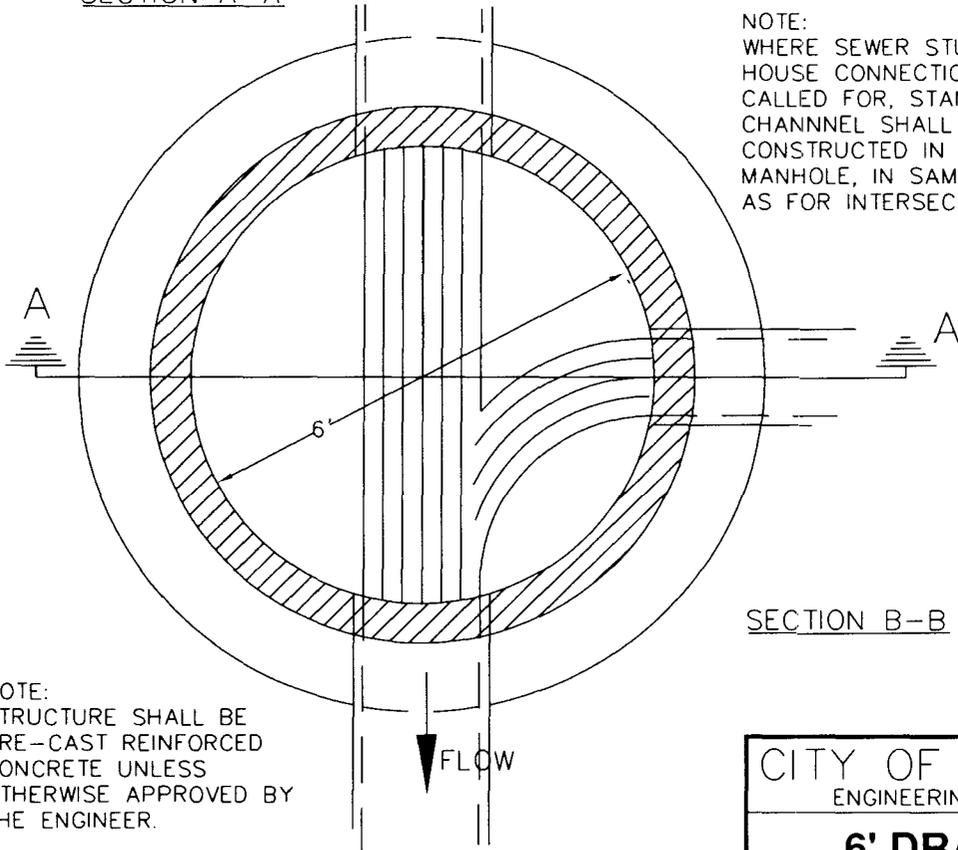

NOTE:  
WHERE SEWER STUBS OR HOUSE CONNECTIONS ARE CALLED FOR, STANDARD CHANNEL SHALL BE CONSTRUCTED IN BOTTOM OF MANHOLE, IN SAME MANNER AS FOR INTERSECTING SEWER.

SECTION B-B

NOTE:  
STRUCTURE SHALL BE PRE-CAST REINFORCED CONCRETE UNLESS OTHERWISE APPROVED BY THE ENGINEER.

NOTE:  
BELOW 15' DEPTH MEASURED FOR PRESENT GROUND SURFACE, MANHOLE WALLS SHALL BE 12" THICK AND DIAMETER OF BASE 9'4"

**6' DRAINAGE STRUCTURE**

CITY OF WYOMING ENGINEERING DEPARTMENT	
<b>6' DRAINAGE STRUCTURE</b>	
DRAWN BY - ML	<b>S-7C</b>
CHECKED BY - RH	
DATE DRAWN - 8-22-2003	
DATE REVISED - 3-3-2009	